

TBL Series(4)




BOLT/Low-volt 3-Phases

- 80 - 120Amp 250V
- Excellent Filtering for Normal Mode and common Mode Noise
- Low Leakage
- Bolt Terminals
- Suitable for Industrial & Medical Equipments, OA & FA Equipments, Measuring Equipments, etc.
- Approved by EN60939-2 


SPECIFICATIONS

Item	UF80TBL	UF100TBL	UF120TBL	Unit
RATED CURRENT	80	100	120	A
RATED VOLTAGE	250 Max			V
TEST VOLTAGE	1,500Vrms between line and earth for 1 minute			/
ISOLATION RESISTANCE	500Vdc 300Mohm between line and earth			/
LEAKAGE CURRENT	1 Max			mA
TEMPERATURE RISE	40 Max			℃
OPERATING TEMPERATURE	-25 ~ +85			℃
APPROVALS	TUV	TUV	TUV	/

BLOCK DIAGRAM

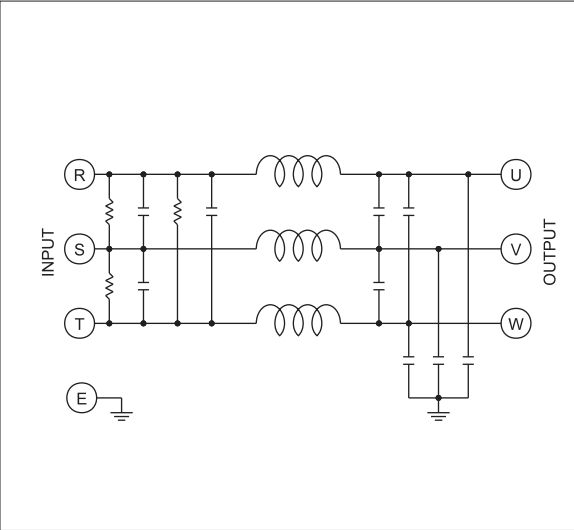


DIMENSIONS(UNITS : MM)

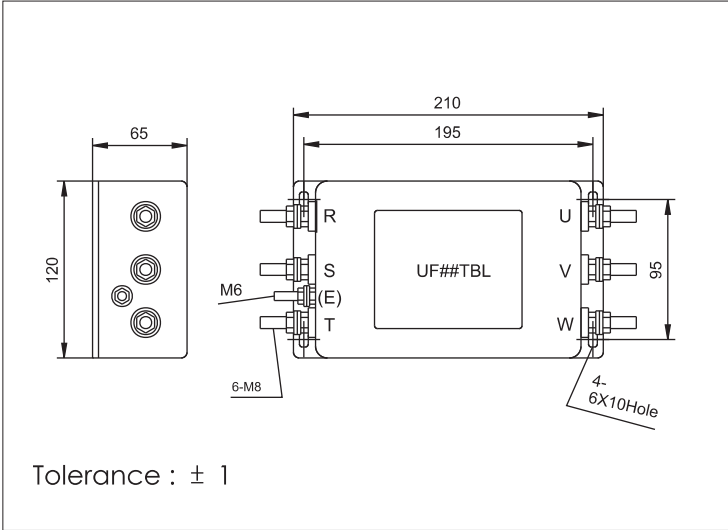


6) TBL Series

A. NORMAL MODE

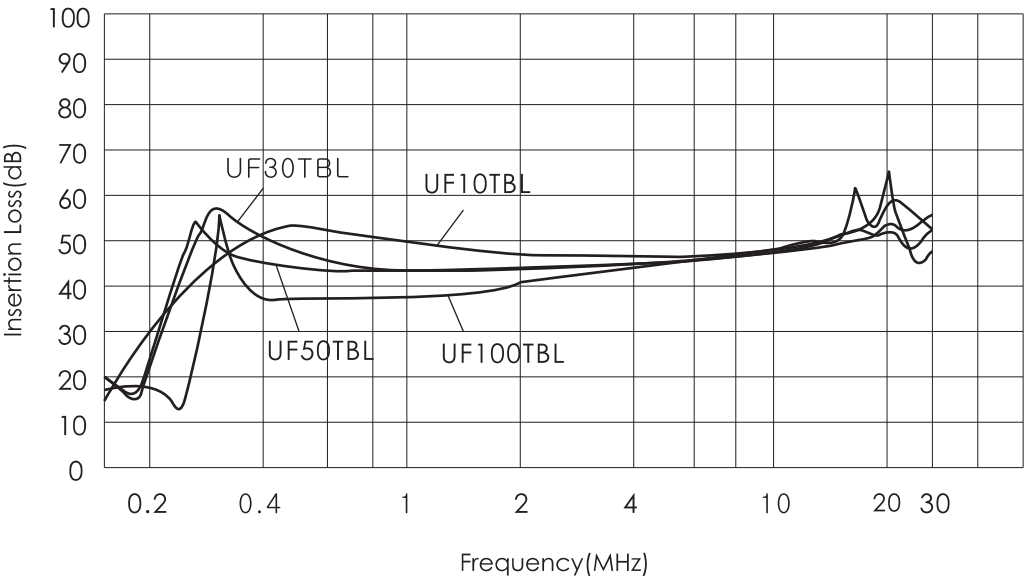

B. COMMON MODE

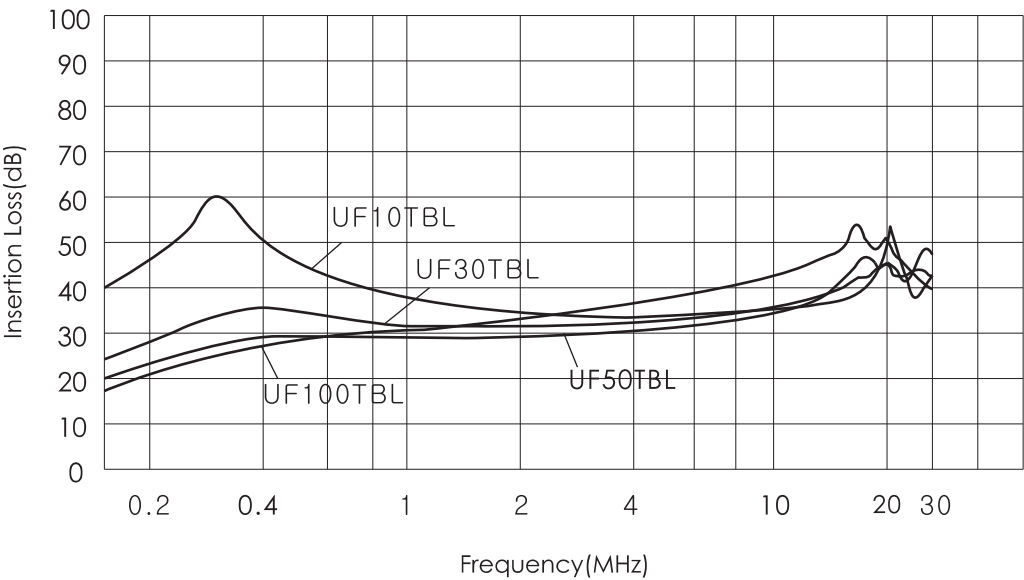

Zertifikat

Certificate



Zertifikat Nr. Certificate No.
R 50103577

Blatt Page
0001

Ihr Zeichen Client Reference
J.J.S.

Unser Zeichen Our Reference
ZKR3-KIS- 13600844 001

Ausstellungsdatum
27.03.2007

Date of Issue
(day/month/year)

Genehmigungsinhaber License Holder

Union Elecom Co., Ltd.
(Chunui Techno Park 1st 1207~1211)
200-1m Chunui-dong, Wonmi-gu,
Bucheon, Gyeonggi-do 420-857
Rep. of Korea

Fertigungsstätte Manufacturing Plant

Union Elecom Co., Ltd.
(Chunui Techno Park 1st 1207~1211)
200-1m Chunui-dong, Wonmi-gu,
Bucheon, Gyeonggi-do 420-857
Rep. of Korea

Prüfzeichen Test Mark

Geprüft nach Tested acc. to
EN 60939-2:2005



Zertifiziertes Produkt (Geräteidentifikation)
Certified Product (Product Identification)

Lizenzentgelte - Einheit
License Fee - Unit

EMC Supressor Filter EMI-Filter

Type Designation : UFXTBL Series
x stands for : Rated Current in A
(5, 10, 20, 30, 40, 50, 60, 80, 100, 120)
Rated Voltage : AC 250V, 50/60Hz
Rated Temperature : 30°C
Climate Category : 25/85/21

5

5

ANLAGE (Appendix): 1

Dem Zertifikat liegt unsere Prüf- und Zertifizierungsordnung zugrunde.
Das Produkt entspricht den o.g. Anforderungen, die Herstellung wird überwacht.
This certificate is based on our Testing and Certification Regulation. The product fulfills above mentioned requirements, the production is subject to surveillance.

Zertifizierungsstelle

TÜV Rheinland Product Safety GmbH, Am Grauen Stein, D-51105 Köln
Tel.: (+49/221)8 06 - 13 71 e-mail: cert-validity@de.tuv.com
Fax: (+49/221)8 06 - 39 35 http://www.tuv.com/safety



Dipl.-Ing. D. Löffler